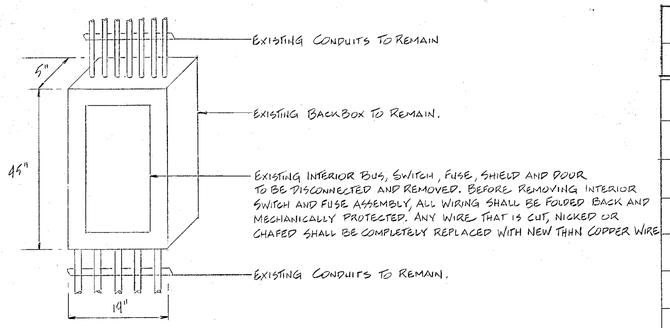

EXISTING FPE SWITCH AND FUSE PANELBOARD DETAIL

NOT TO SCALE

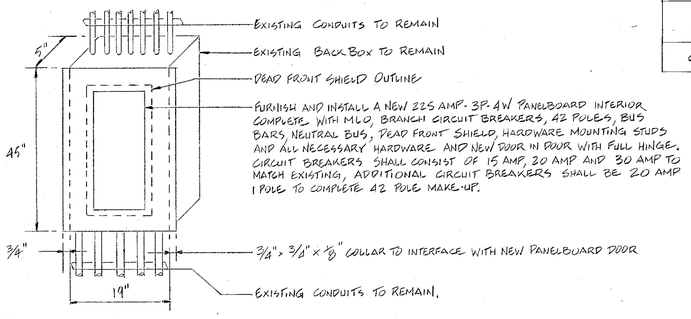

EXISTING PANELBOARD BACKBOX WITH NEW INTERIOR DETAIL

NOT TO SCALE

FIXTURE SCHEDULE						
TYPE	MANUFACTURER	CATALOG No.	LAMP No.	LAMP TYPE	VOLTAGE	REMARKS.
A	LITHONIA	2 SP G232 A12 SSB TU	2	TB 3500°K	120	2'-0" x 4'-0" RECESSED, 4 1/2" MAX. DEPTH, .125 LENS, ELECTRONIC BALLAST
A_1	LITHONIA	2PM3 GB 332 18 120 SSB TU	3	TB 3500°K	120	2'-0" x 4'-0" RECESSED, PARABOLIC TROFFER ELECTRONIC BALLAST
B	LITHONIA	2 SPG 2U 32 A12 SSB TU	2	TBU 3500°K	120	2'-0" x 2'-0" RECESSED FIXTURE, ELECTRONIC BALLAST.
L	LITECONTROL	WD 06N14RS	1	TB 3500°K	120	WALL MOUNTED DIRECT LIGHTING, ELECTRONIC BALLAST
G	LITHONIA	TWP 70 SPEK	1	70W HPS	120	HID WALL PAK WITH PHOTOELECTRIC CONTROL
EX-1	LITHONIA	ELE SW 1R	ELECTROLUMINESCENT LAMP PANEL		120	ELECTROLUMINESCENT EXIT SIGN, WHITE FINISH, RED LETTERS, UNIVERSAL MOUNT, SINGLE FACE
EX-2	LITHONIA	ELE SW 2R	ELECTROLUMINESCENT LAMP PANEL		120	SAME AS ABOVE EXCEPT DOUBLE FACE, DIRECTIONAL ARROW AS REQ.
EM-2	LITHONIA	ELU 2PN	2	N0806 - 8W	120	2-LAMP SELF CONTAINED EMER. LIGHT, 6V, 1.5 HOURS.
M	LITECONTROL	WD 06N28RS	2	TB 3500°K	120	WALL MOUNTED DIRECT LIGHTING, ELECTRONIC BALLAST
A_3	LITHONIA	2 SP G332 A12 SSB TU	3	TB 3500°K	120	2'-0" x 4'-0" RECESSED 4 1/2" MAX. DEPTH, .125 LENS, ELECTRONIC BALLAST, SAME AS 'A', EXCEPT 3 LAMP
O	HOLOPHANE	MDWP 100HP 12 B2 P2 12 PA	1	100W HPS	120	

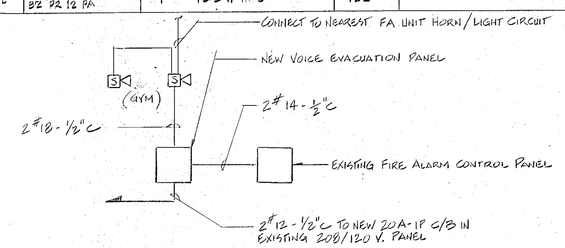

VOICE EVACUATION RISER DIAGRAM

SYMBOL LEGEND	
SYMBOL	DESCRIPTION
	2'-0" x 4'-0" FLUORESCENT LIGHTING FIXTURE
	EMERGENCY LIGHTING FIXTURE
	1'-0" x 4'-0" FLUORESCENT LIGHTING FIXTURE
	2'-0" x 2'-0" FLUORESCENT LIGHTING FIXTURE
	INCANDESCENT LIGHTING FIXTURE
	SINGLE FACE EXIT LIGHTING FIXTURE — SHADED AREA DESIGNATES FACE, ARROW INDICATES DIRECTION. CONNECT EXIT SIGN TO LINE SIDE OF LOCAL LIGHTING CIRCUIT, NEW AND/OR EXISTING CIRCUIT.
	DOUBLE FACE EXIT LIGHTING FIXTURE
	WALL MOUNTED EXIT LIGHTING FIXTURE
E	EMERGENCY LIGHTING FIXTURE
	EMERGENCY LIGHTING FIXTURE
E	EMERGENCY CALL FOR AID SWITCH - AUTH 200 PD2
	CALL FOR AID LIGHT/HORN - AUTH 945-075-03
T	LOW VOLTAGE TRANSFORMER WITH ENCLOSURE 150VA - AUTH 127 120/24V (MOUNT ABOVE CLG)
PR	PORCELAIN RECEPTACLE
S	SINGLE POLE SWITCH
S_3	THREE WAY SWITCH
S_B	BURNER EMERGENCY DISCONNECT SWITCH
S_{CS}	EXISTING CALL SWITCH
S_K	KEY OPERATED SWITCH
S_M	REMOTE CONTROL SWITCH
S_T	THERMAL OVERLOAD SWITCH
	COMBINATION STARTER
O_D	DATA OUTLET
	DUPLEX RECEPTACLE — WIREMOLD SURGE SUPPRESSION TYPE, CATALOG No. 53TB2-G TYPE S, GREY, 125 V.-20 A.
	DUPLEX RECEPTACLE
	DUPLEX RECEPTACLE ABOVE COUNTER
	SPECIAL OUTLET TO SUIT EQUIPMENT
Y	TELEVISION OUTLET
	INTERCOM - HAND SET
	TELEPHONE
1/2	MOTOR (HP AS INDICATED)
	DISCONNECT SWITCH
	MAGNETIC STARTER
	BELL OR ALARM
S	SPEAKER
S	SMOKE DETECTOR
H	HEAT DETECTOR
M	MAGNETIC DOOR HOLDER
F	FIRE ALARM PULL STATION
F	FIRE ALARM HORN AND FLASHING LIGHT COMBINATION.
C S	CLOCK AND SPEAKER PANEL
	PANELBOARD
SD	DUCT SMOKE DETECTOR
e	EXISTING TO REMAIN.
er	'er' DESIGNATES EXISTING TO BE RELOCATED
r	'r' DESIGNATES EXISTING TO BE REMOVED
A.F.F.	ABOVE FINISHED FLOOR
G.F.C.I.	GROUND FAULT CIRCUIT INTERRUPTER
WP	WEATHERPROOF
FD	FIRE DAMPER

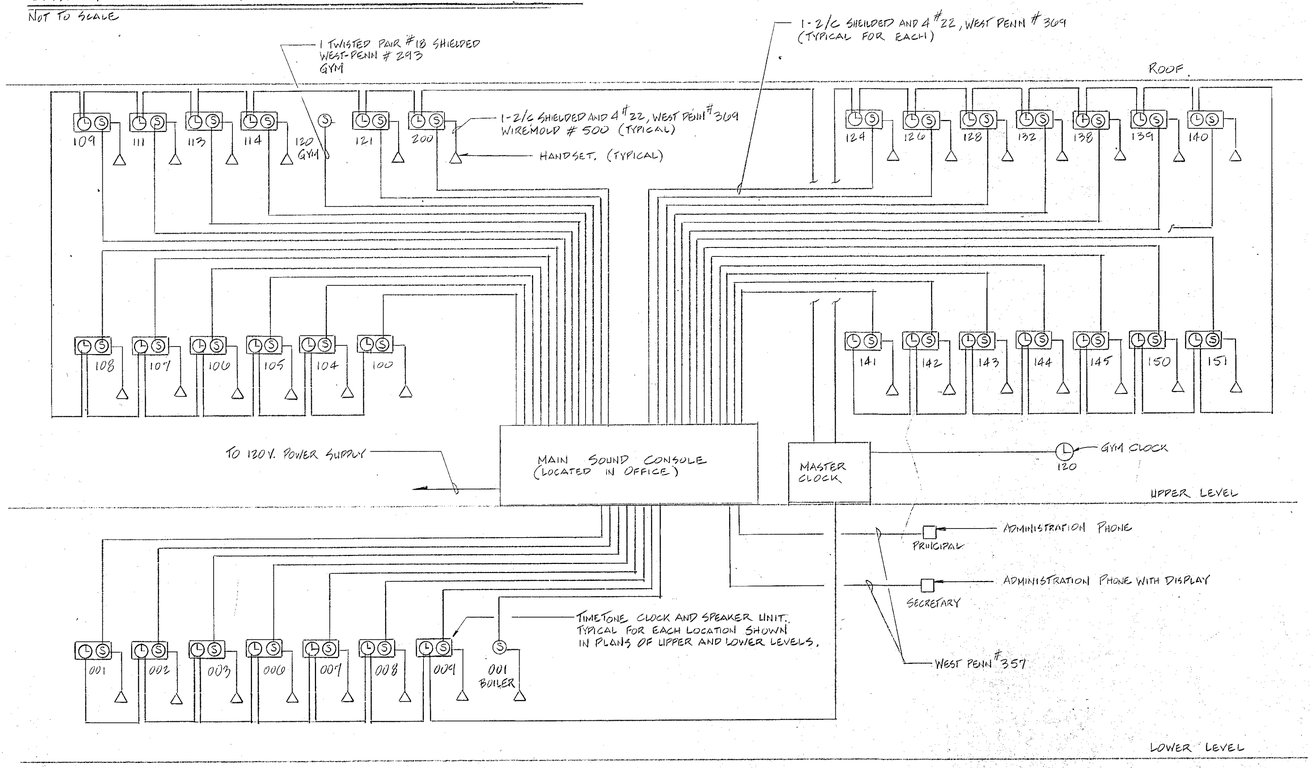

SOUND SYSTEM/TELEPHONE RISER DIAGRAM

NOT TO SCALE

NOTE: PROVIDE NEW WIRING, UTILIZE EXISTING RACEWAYS AS REQUIRED

JANSEN & ROGAN
CONSULTING ENGINEERS, P.C.
121 WHITNEY AVENUE
NEW HAVEN, CT. 06510

STATE PROJECT # 034:89:115 EA

Antinozzi Associates Architects
4021 Main Street
Stratford, Connecticut

DANBURY SCHOOLS REORGANIZATION
CITY OF DANBURY

PARK AVENUE ELEMENTARY
DANBURY CONNECTICUT

RISER DIAGRAMS, FIXTURE SCHEDULE, SYMBOL LIST.

CHECKED BY	SCALE NOTED	DATE 7-24-91	JOB NO. E15-4