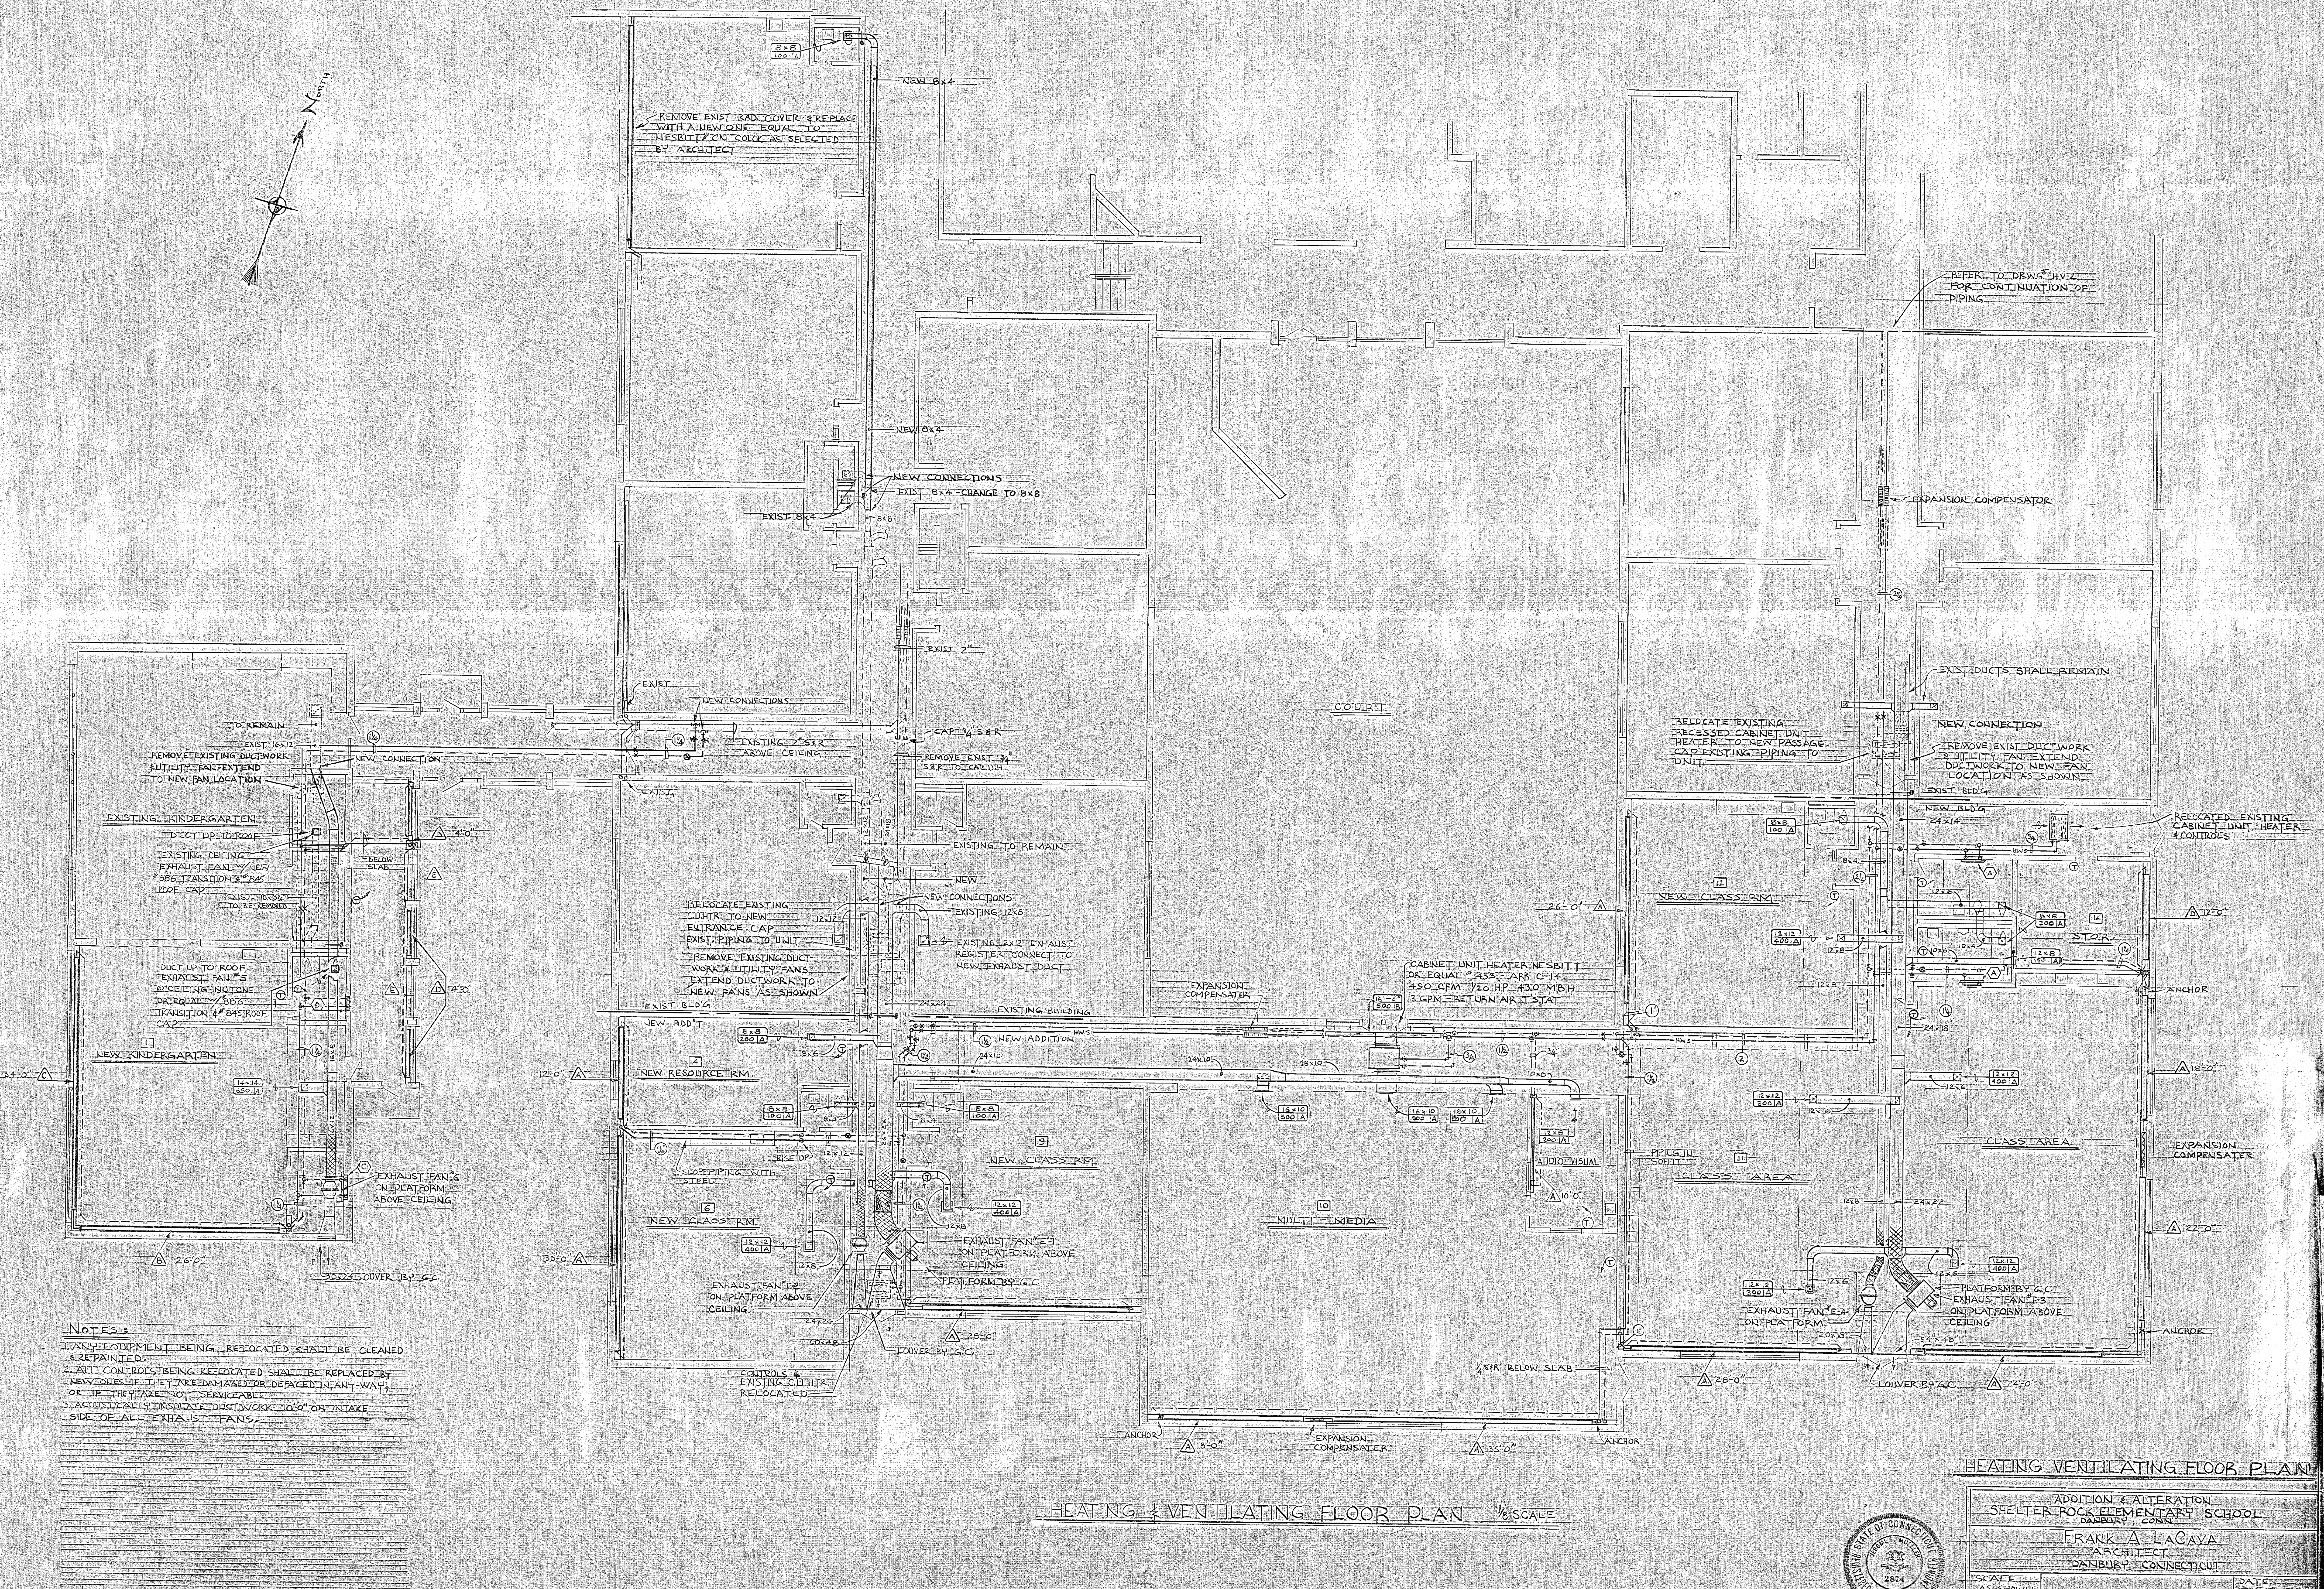

NOTES:

1. ANY EQUIPMENT BEING RE-LOCATED SHALL BE CLEANED & RE-PAINTED.
2. ALL CONTROLS BEING RE-LOCATED SHALL BE REPLACED BY NEW ONES IF THEY ARE DAMAGED OR DEFACED IN ANY WAY, OR IF THEY ARE NOT SERVICEABLE.
3. ACOUSTICALLY INSULATE DUCTWORK 10'-0" ON INTAKE SIDE OF ALL EXHAUST FANS.

HEATING VENTILATING FLOOR PLAN

ADDITION & ALTERATION
SHELTER ROCK ELEMENTARY SCHOOL
DANBURY, CONN

FRANK A. LaCAVA
ARCHITECT
DANBURY, CONNECTICUT

SCALE AS SHOWN	DATE 4-3-72
REVISIONS	DRWG NO. HV-1